


TYPE 1


COMBINATION ROLL CURB AND GUTTER

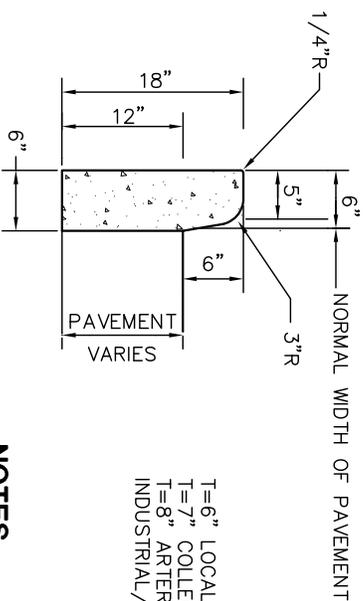

TYPE 6

BARRIER CURB


T=6" LOCAL
T=7" COLLECTOR
T=8" ARTERIAL/
INDUSTRIAL/COMMERCIAL

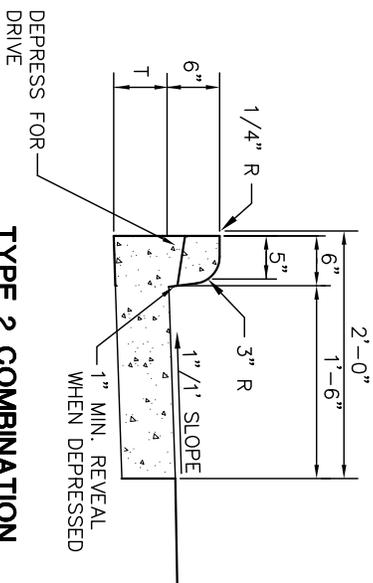

NOTES

TYPE 2 COMBINATION CURB AND GUTTER

- A.** CONCRETE WORK SHALL MEET THE REQUIREMENTS SET FORTH IN ODOT ITEM 609 CURBING.
- B.** CURBING SHALL HAVE CONTRACTION JOINTS EVERY 10'.
- C.** MINIMUM OF 6" OF ODOT 304 SHALL BE PLACED UNDER CURBING.
- D.** CURBING SHALL BE BACKFILLED IMMEDIATELY AFTER FORMS ARE REMOVED OR AS SOON AS PRACTICAL WHEN SLIP FORMING PRIOR TO OTHER CONSTRUCTION OPERATIONS.
- E.** PROVIDE BROOM FINISH AND EDGING TO ALL EXPOSED SURFACES.
- F.** APPLY CLEAR CURING COMPOUND ON ALL SURFACES INCLUDING BACK IMMEDIATELY AFTER FINISHING SURFACES. ANY OTHER METHOD OR TYPE OF CURING COMPOUND MUST BE PREAPPROVED.
- G.** CONCRETE SHALL BE ODOT CLASS C WITH FIBERMESH (4000 PSI, 600LB/CY CEMENT). PROPORTIONING OPTIONS 1 AND 2 NOT ALLOWED.
- H.** CONCRETE SHALL CONTAIN 6% ± 1% OF TOTAL AIR.
- I.** TYPE 6 CURBS ARE FOR USE AROUND MEDIAN SECTION.
- J.** UNDERDRAIN MUST BE INSTALLED PRIOR TO CURB INSTALLATION.
- K.** MINIMUM FLOW LINE SLOPE OF PERFORATED PIPE IS 0.003 FT/FT TO OUTLET.
- L.** MACHINE CUTTING THE BACK OF CURB MAY BE DONE. APPROVAL FROM CITY ENGINEER PRIOR TO CUTTING IS REQUIRED.

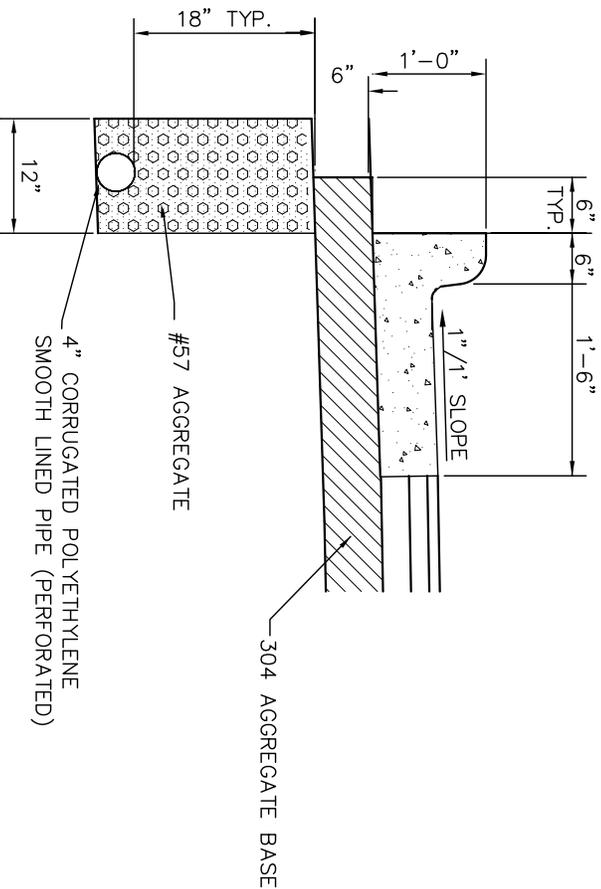

4" SHALLOW PIPE UNDERDRAIN DETAIL
TO BE USED IN NEW DEVELOPMENT WHEN
WARRANTED BY GROUND WATER CONDITIONS.