


2" FIRE LINE SERVICE
(METER REQUIRED)

- SERVICE TEES ARE PERMITTED IF**
- A. SHOWN ON AN APPROVED SET OF CONSTRUCTION DRAWINGS.
 - B. 4" MINIMUM BRANCH AND SERVICE LINE WITH GATE VALVE WITHIN 3' OF MAIN.
 - C. 6" FIRE LINE MAY HAVE A ONE-INCH DOMESTIC TAP AND 8" FIRE LINE MAY HAVE A 1-1/2" DOMESTIC TAP. ALL DOMESTIC TAPS MUST BE INSTALLED BEFORE THE FIRE SPRINKLER RISER.

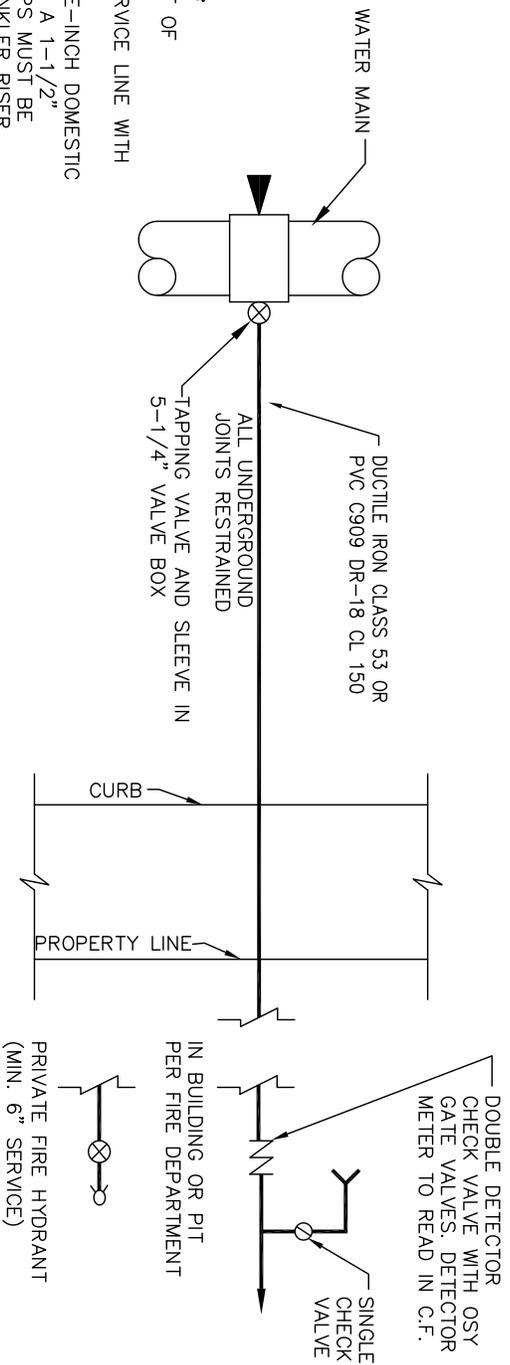

4" AND LARGER FIRE LINE SERVICE
(METER REQUIRED)

WALL/POST INDICATOR VALVES SHALL BE ADDED ON PREMISES AT FIRE DEPARTMENT REQUEST

REVISIONS:

DATE

APPROVED:
FEB. 2002

PAGE No.

800-19