


WIRE SHALL HAVE 5' OF WIRE TO EXTEND OUT OF VALVE BOX

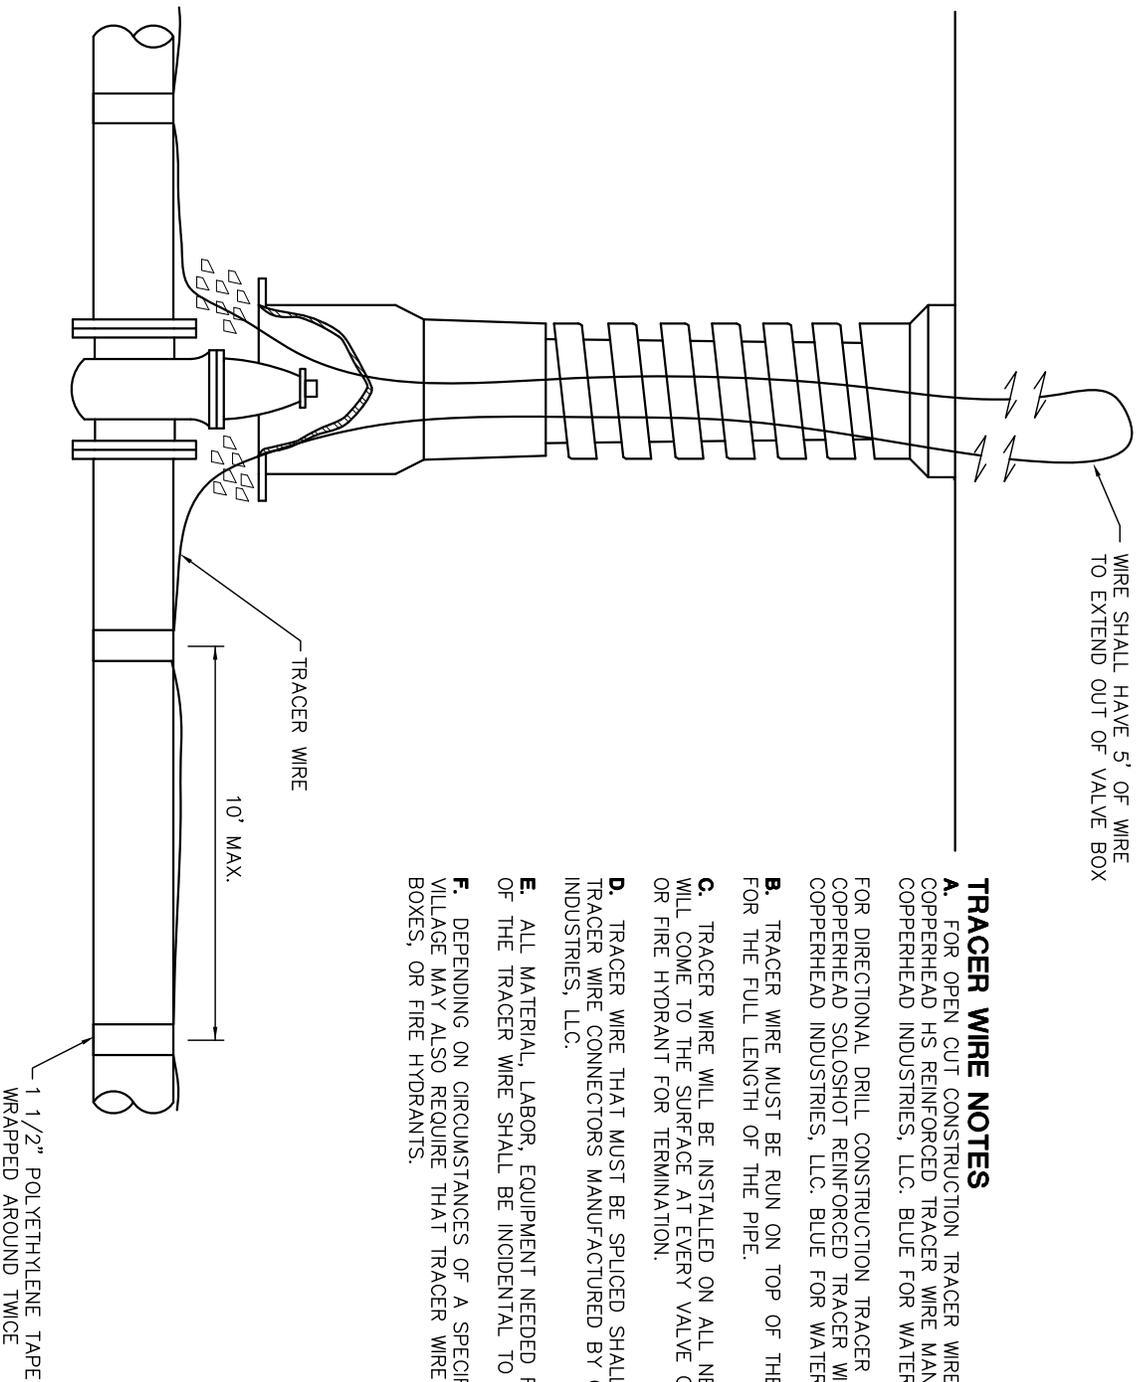

**TRACER WIRE NOTES**

- A.** FOR OPEN CUT CONSTRUCTION TRACER WIRE SHALL BE COPPERHEAD HS REINFORCED TRACER WIRE MANUFACTURED BY COPPERHEAD INDUSTRIES, LLC. BLUE FOR WATER.
- FOR DIRECTIONAL DRILL CONSTRUCTION TRACER WIRE SHALL BE COPPERHEAD SOLOSHOT REINFORCED TRACER WIRE MANUFACTURED BY COPPERHEAD INDUSTRIES, LLC. BLUE FOR WATER.
- B.** TRACER WIRE MUST BE RUN ON TOP OF THE PIPE CONTINUOUSLY FOR THE FULL LENGTH OF THE PIPE.
- C.** TRACER WIRE WILL BE INSTALLED ON ALL NEW INSTALLATION AND WILL COME TO THE SURFACE AT EVERY VALVE CHAMBER, VALVE BOX, OR FIRE HYDRANT FOR TERMINATION.
- D.** TRACER WIRE THAT MUST BE SPLICED SHALL USE SNAKEBITE TRACER WIRE CONNECTORS MANUFACTURED BY COPPERHEAD INDUSTRIES, LLC.
- E.** ALL MATERIAL, LABOR, EQUIPMENT NEEDED FOR THE INSTALLATION OF THE TRACER WIRE SHALL BE INCIDENTAL TO PIPE INSTALLATION.
- F.** DEPENDING ON CIRCUMSTANCES OF A SPECIFIC INSTALLATION, THE VILLAGE MAY ALSO REQUIRE THAT TRACER WIRE BE RUN TO CURB BOXES, OR FIRE HYDRANTS.